

# *Certificate of Conformance*

*to*

*EN 15767-1 (2009) Portable Monitor*

*Task Force Tips, Inc. certifies that the following Portable Monitors meet or exceed the requirements found in the EN 15767-1 (2009) Portable Monitor standard.*

## **Partner/Blitzfire/Blitzfire-HE**

*Test data is available upon request or on our website. [www.tft.com](http://www.tft.com)*



***TASK FORCE TIPS***

*Delivers what our customers need, when they need it.*



**TASK FORCE TIPS, INC**  
**REGISTERED TO ISO 9001:2008**  
**FILE NUMBER 10001004 QM08**

### Annex C (normative)

#### C.1 General Data

<b>Manufacturer</b>	Task Force Tips, Inc.
<b>Model</b>	Partner/Blitzfire/Blitzfire-HE
<b>Maximum stated flowrate (l/min) Qmax</b>	2000 l/min

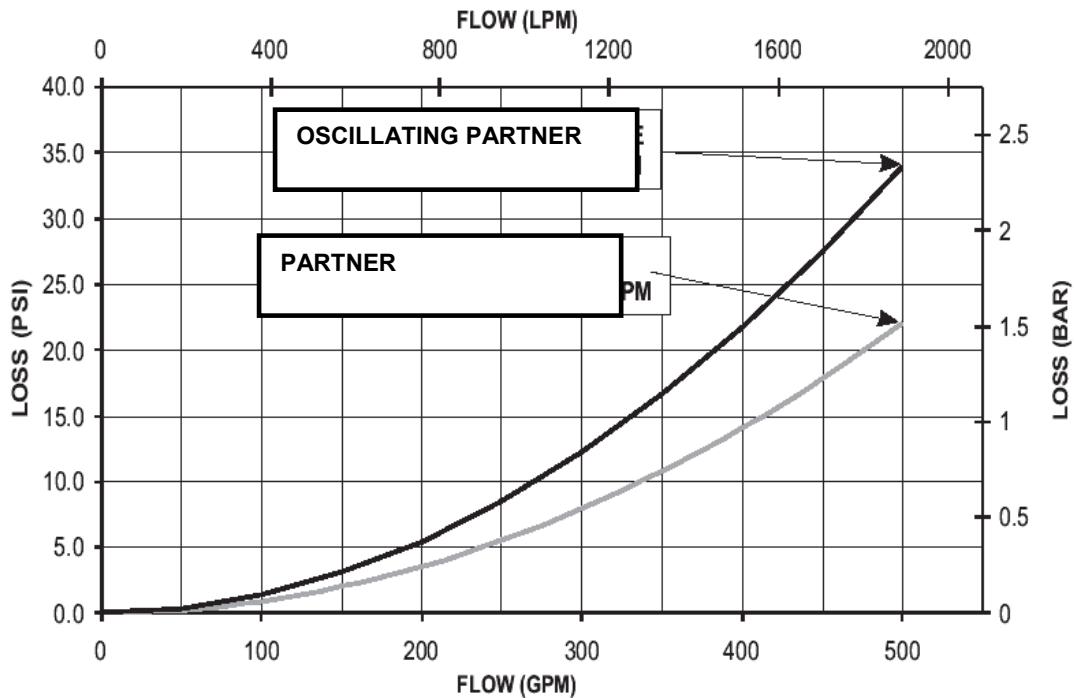


Figure C.1- Pressure loss chart

#### C.2 Operational devices

<b>Fitting System</b>	Swiveling
<b>Horizontal and Vertical travel device (optional)</b>	None
<b>Open and shut off device (optional)</b>	Bale Handle
<b>Oscillating device (optional)</b>	Adjustable 20°, 30° or 40° sweep
<b>Safety device against uncontrolled motion (optional)</b>	Yes

### C.3 Requirements

Number of the relevant clause of this part of the standard	Item	Requirement	Test Result	
5.1.2	<b>Maximum mass (kg)</b>	20 kg	10 kg	
5.1.3.2	<b>Max torques (N·m) or forces (N),</b> needed to move operating elements	Valve Handle	20 N·m	16.3 N·m
		Fitting Systems	15 N·m	3.45 N·m
		Handle Pull Pin	100 N	8.9 N
		Leg Deployment	100 N	17.8 N
5.2	<b>Sensitivity to frost (°C)</b>	-15° C	-15° C	
5.3.1	<b>Burst pressure (bar) if higher than 35 bar</b>	35bar	40bar	
6.4	<b>Stability test-</b> movement in (cm), in any direction, in addition to that caused by the expansion of hose(s)	50 cm	0 cm	

### C.4 Optional extra data (no requirements)

Ageing test	n/a
UV test	n/a
Ozone test	n/a
Corrosion test	n/a

### C.5 Data certified by

Adam Ritchey  
Quality Manager  
Task Force Tips